


130-B, HARDING AVE. BELLMAWR, NJ 08031
 P.O. BOX 727 BELLMAWR, NJ 08099-0029
 PHONE: 1-800-648-2625 or 856-931-0011
 FAX: 856-931-5205
 EMAIL: lab@analaboratories.com

Lab Number: S09M18457
 Customer I.D: AMTRAKTX
 Source: 500 BASELINE
 Sample Date: 12/22/2009
 Product Type: B-100
 Report Date: 12/31/2009

AMTRAK
 ATTENTION:
 TIM COOPER
 400 SOUTH HOUSTON ST. STE. 100
 DALLAS, TX 75202

TEST DESCRIPTION	ASTM	SPECIFICATION	RESULT	UNITS
1) Flash Point	D-93	130 minimum	165	degrees Celsius
2) Water and Sediment	D-2709	0.0500 maximum	0.0150	volume %
3) Kinematic Viscosity @ 40 C	D-445	1.9 - 6.0	4.62	cSt
4) Sulfated Ash	D-874	0.020 maximum	0.001	weight %
5) Sulfur	D-5453	15 maximum	0.0005	parts per million
6) Copper Strip Corrosion	D-130	No. 3 maximum	1a	rating
7) Cetane Index	D-976	47 minimum	60.3	
8) Cloud Point	D-2500	Report	17	degrees Celsius
9) Carbon Residue	D-4530	0.0050 maximum	0.0031	weight %
11) Acid Number	D-664	0.50 maximum	0.30	mg KOH/g
12) Free Glycerin	D-6584	0.020 maximum	0.230 **	volume %
13) Total Glycerin	D-6584	0.240 maximum	0.250 **	volume %
14) Phosphorus	D-4951	0.0010 maximum	<0.0001	weight %
14) Distillation Temperature 90%	D-1160	360 maximum	341	degrees Celsius
15) Calcium and Magnesium	EN14538	5 maximum	<1	parts per million
16) Sodium and Potassium	EN14538	5 maximum	<1	parts per million
17) Oxidation Stability	EN14112	3 minimum	>10	hours

Comment: Results for Free and Total Glycerin are not with ASTM specifications.

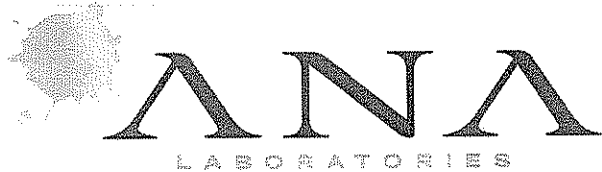


130-B, HARDING AVE. BELLMAWR, NJ 08031
 P.O. BOX 727 BELLMAWR, NJ 08099-0029
 PHONE: 1-800-648-2625 or 856-931-0011
 FAX: 856-931-5205
 EMAIL: lab@analaboratories.com

Lab Number: S10B2442
 Customer I.D: AMTRAKTX
 Source: 500 B100
 Sample Date: 1/21/2010
 Product Type: B-100
 Report Date: 2/12/2010

AMTRAK
 ATTENTION:
 TIM COOPER
 400 SOUTH HOUSTON ST. STE. 100
 DALLAS, TX 75202

TEST DESCRIPTION	ASTM	SPECIFICATION	RESULT	UNITS
1) Flash Point	D-93	130 minimum	146	degrees Celsius
2) Water and Sediment	D-2709	0.0500 maximum	0.0100	volume %
3) Kinematic Viscosity @ 40 C	D-445	1.9 - 6.0	4.67	cSt
4) Sulfated Ash	D-874	0.020 maximum	0.001	weight %
5) Sulfur	D-5453	15 maximum	0.0007	parts per million
6) Copper Strip Corrosion	D-130	No. 3 maximum	1a	rating
7) Cetane Index	D-976	47 minimum	59.1	
8) Cloud Point	D-2500	Report	17	degrees Celsius
9) Carbon Residue	D-4530	0.0050 maximum	0.049	weight %
11) Acid Number	D-664	0.50 maximum	0.28	mg KOH/g
12) Free Glycerin	D-6584	0.020 maximum	0.00	volume %
13) Total Glycerin	D-6584	0.240 maximum	0.00	volume %
14) Phosphorus	D-4951	0.0010 maximum	<0.0001	weight %
14) Distillation Temperature 90%	D-1160	360 maximum	331	degrees Celsius
15) Calcium and Magnesium	EN14538	5 maximum	<1	parts per million
16) Sodium and Potassium	EN14538	5 maximum	<1	parts per million
17) Oxidation Stability	EN14112	3 minimum	>10	hours

Comment: Results are within specifications.

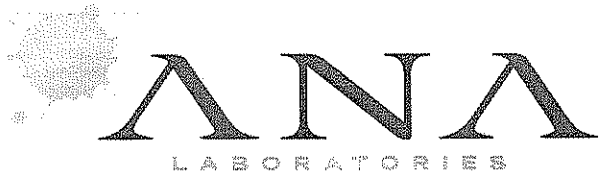

130-B, HARDING AVE. BELLMAWR, NJ 08031
 P.O. BOX 727 BELLMAWR, NJ 08099-0029
 PHONE: 1-800-648-2625 or 856-931-0011
 FAX: 856-931-5205
 EMAIL: lab@analaboratories.com

Lab Number: S10B9637
 Customer I.D: AMTRAKTX
 Source: Fort Worth
 B-100
 Sample Date: 2/9/2010
 Product Type: B-100
 Report Date: 2/22/2010

AMTRAK
 ATTENTION:
 TIM COOPER
 400 SOUTH HOUSTON ST. STE. 100
 DALLAS, TX 75202

TEST DESCRIPTION	ASTM	SPECIFICATION	RESULT	UNITS
1) Flash Point	D-93	130 minimum	163	degrees Celsius
2) Water and Sediment	D-2709	0.0500 maximum	0.0100	volume %
3) Kinematic Viscosity @ 40 C	D-445	1.9 - 6.0	4.69	cSt
4) Sulfated Ash	D-874	0.020 maximum	0.001	weight %
5) Sulfur	D-5453	15 maximum	0.0007	parts per million
6) Copper Strip Corrosion	D-130	No. 3 maximum	1a	rating
7) Cetane Index	D-976	47 minimum	58.9	
8) Cloud Point	D-2500	Report	17	degrees Celsius
9) Carbon Residue	D-4530	0.0050 maximum	0.022	weight %
11) Acid Number	D-664	0.50 maximum	0.28	mg KOH/g
12) Free Glycerin	D-6584	0.020 maximum	0.095**	volume %
13) Total Glycerin	D-6584	0.240 maximum	0.101	volume %
14) Phosphorus	D-4951	0.0010 maximum	<0.0001	weight %
14) Distillation Temperature 90%	D-1160	360 maximum	338	degrees Celsius
15) Calcium and Magnesium	EN14538	5 maximum	<1	parts per million
16) Sodium and Potassium	EN14538	5 maximum	<1	parts per million
17) Oxidation Stability	EN14112	3 minimum	>10	hours

Comment: **Test result is not within specifications.



130-B, HARDING AVE. BELLMAWR, NJ 08031
 P.O. BOX 727 BELLMAWR, NJ 08099-0029
 PHONE: 1-800-648-2625 or 856-931-0011
 FAX: 856-931-5205
 EMAIL: lab@analaboratories.com

Lab Number: S10L4238
 Customer I.D: AMTRAKTX
 Source: Fort Worth
 B-100
 Sample Date: 10/27/2010
 Product Type: B-100
 Report Date: 11/11/2010

AMTRAK
 ATTENTION:
 TIM COOPER
 400 SOUTH HOUSTON ST. STE. 100
 DALLAS, TX 75202

TEST DESCRIPTION	ASTM	SPECIFICATION	RESULT	UNITS
1) Flash Point	D-93	130 minimum	179	degrees Celsius
2) Water and Sediment	D-2709	0.0500 maximum	0.0100	volume %
3) Kinematic Viscosity @ 40 C	D-445	1.9 - 6.0	4.76	cSt
4) Sulfated Ash	D-874	0.020 maximum	0.001	weight %
5) Sulfur	D-5453	15 maximum	0.0014	parts per million
6) Copper Strip Corrosion	D-130	No. 3 maximum	1a	rating
7) Cetane Index	D-976	47 minimum	59.6	
8) Cloud Point	D-2500	Report	16	degrees Celsius
9) Carbon Residue	D-4530	0.0050 maximum	0.029	weight %
11) Acid Number	D-664	0.50 maximum	0.3	mg KOH/g
12) Free Glycerin	D-6584	0.020 maximum	0.0	volume %
13) Total Glycerin	D-6584	0.240 maximum	0.0	volume %
14) Phosphorus	D-4951	0.0010 maximum	<0.0001	weight %
14) Distillation Temperature 90%	D-1160	360 maximum	336	degrees Celsius
15) Calcium and Magnesium	EN14538	5 maximum	<1	parts per million
16) Sodium and Potassium	EN14538	5 maximum	<1	parts per million
17) Oxidation Stability	EN14112	3 minimum	>10	hours

Comment: Test data as per your request.